

$R=17'-0"$
 WITHIN THE ENTIRE 50% CRZ, THE EXISTING SUBGRADE SHALL NOT BE DISTURBED - NO SCARIFYING. FILL SHALL BE PLACED OVER NATURAL UNDISTURBED SUBGRADE.

NOTE 5

8" MIN CONC SLAB (NOTE 4)
 SLOPE 1/8"/FT
 3.5'

NOTE 3

4.5" CONC SLAB (NOTE 2) (TYP)

TYP INT BM

TYP INT BM


FOUNDATION PLAN

$1/4" = 1'-0"$ IN 24X36
 $1" = 10'-0"$ IN 11X17

PLAN NOTES:

1. VERIFY ALL DIMENSIONS, SLAB DROPS W/ ARCHITECTURAL DRAWINGS PRIOR TO STARTING WORK.
2. 4.5" SLAB OVER VAPOR RETARDER OVER COMPACTED STRUCTURAL FILL. REINF SLAB WITH #3 @ 12" O.C.E.W. AT MID DEPTH. SEE NOTES FOR STRUCTURAL FILL REQUIREMENTS.
3. 2-#3x4'-0" CORNER BARS - TYPICAL AT ALL RE-ENTRANT CORNERS.
4. 8" MIN SLAB OVER VAPOR RETARDER OVER COMPACTED STRUCTURAL FILL. REINF SLAB WITH #4 @ 8" O.C.E.W. AT MID DEPTH. SEE NOTES FOR STRUCTURAL FILL REQUIREMENTS.
5. 3-#4 @ 4" O.C. ALONG EDGE OF SLAB. SEE 4/S2.

Zhiqiang Zhang
3/31/2015

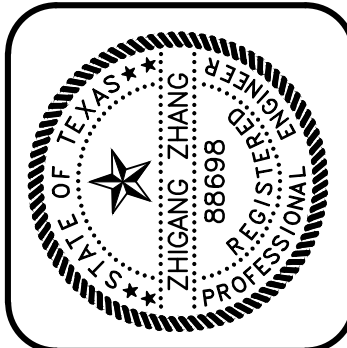

GREENEARTH ENGINEERING, INC.
 STRUCTURAL CONSULTING ENGINEERS
 2500 WEST WILLIAM CANNON DR., #201 AUSTIN, TX 78746
 PHONE (512) 299-8585 FAX (512) 462-0660
 GE JOB NO.: 15069

69 MILDRED ST
 AUSTIN, TX

REV.	DATE

CHK. BY: TZ
 DRWN. BY: BB
 DATE: 4/7/2015

SHEET NO.
S1
 OF